


METERING FAUCETS

CONVENTIONAL WIDESPREAD 0.5 GPM NON-AERATED SPRAY

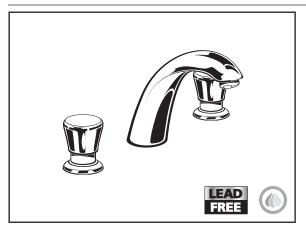

GENERAL DESCRIPTION:


Metering widespread faucet. Vandal-resistant solid brass construction. Easy-push handles. Water conserving pressure compensating 0.5 GPM vandal-resistant non-aerated spray. Factory set f or a maximum of 0.083 gallon flow per activation. Replaceable cartridge. Adjustable flow cycle.

MODEL NUMBER:

☐ 1340.827 Widespread, 0.5 GPM pressure compensating vandal-resistant non-aerated spray.

PRODUCT FEATURES:

- Meets CALGreen: Delivers 0.083 gallons per cycle which is a 59% water savings from CALGreen baseline.
- Pressure Compensating Non-Aerated Spray: Provides a constant water flow of 0.5 gpm throughout the pressure range.
- Vandal-Resistant Brass Construction and Spray: Durable - Excellent in high use applications.
- Automatic Shut-off: Stops water and energy waste. Ideal for public restrooms where uncontrolled water usage is costly.
- Meets ADA Standard: Requires less than 5 lbs. of operating force to initiate flow per ANSI A117.1.
- Adjustable Flow Cycle
- Replaceable Valve Cartridge: Facilitates simple replacement.
- Hot/Cold Button Indicators
- Lead Free: Faucet contains ≤ 0.25% total lead content by weighted average.
- Minimum Operating Pressure: 20 psi

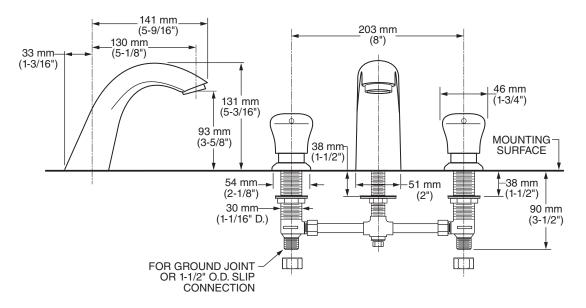

SUGGESTED SPECIFICATION

Metering faucet shall feature a vandal-resistant brass construction with a replaceable valve cartridge and an adjustable flow cycle. Shall also feature a water-conserving, pressure compensating 0.5 gpm/1.9L/min vandal-resistant non-aerated spray. Factory set to deliver 0.083 gallons per cycle to meet CALGreen. Push button activator shall meet ANSI A117.1 Standard. Fitting shall be American Standard Model #1340.827.002.

© 2018 AS America Inc. 3/18




METERING FAUCETS

CONVENTIONAL WIDESPREAD 0.5 GPM NON-AERATED SPRAY

CODES AND STANDARDS

These products meet or exceed the following codes and standards:

ANSI A117.1 ASME A112.18.1 CSA B 125 NSF 61/Section 9 and Annex G CALGreen

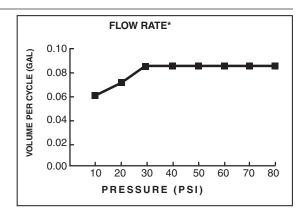

Meets the American Disabilities Act Guidelines

ANSI A117.1 Requirements for the accessible
and usable building facilities - check local codes.